



G - CONFIG 1

03-31-2013

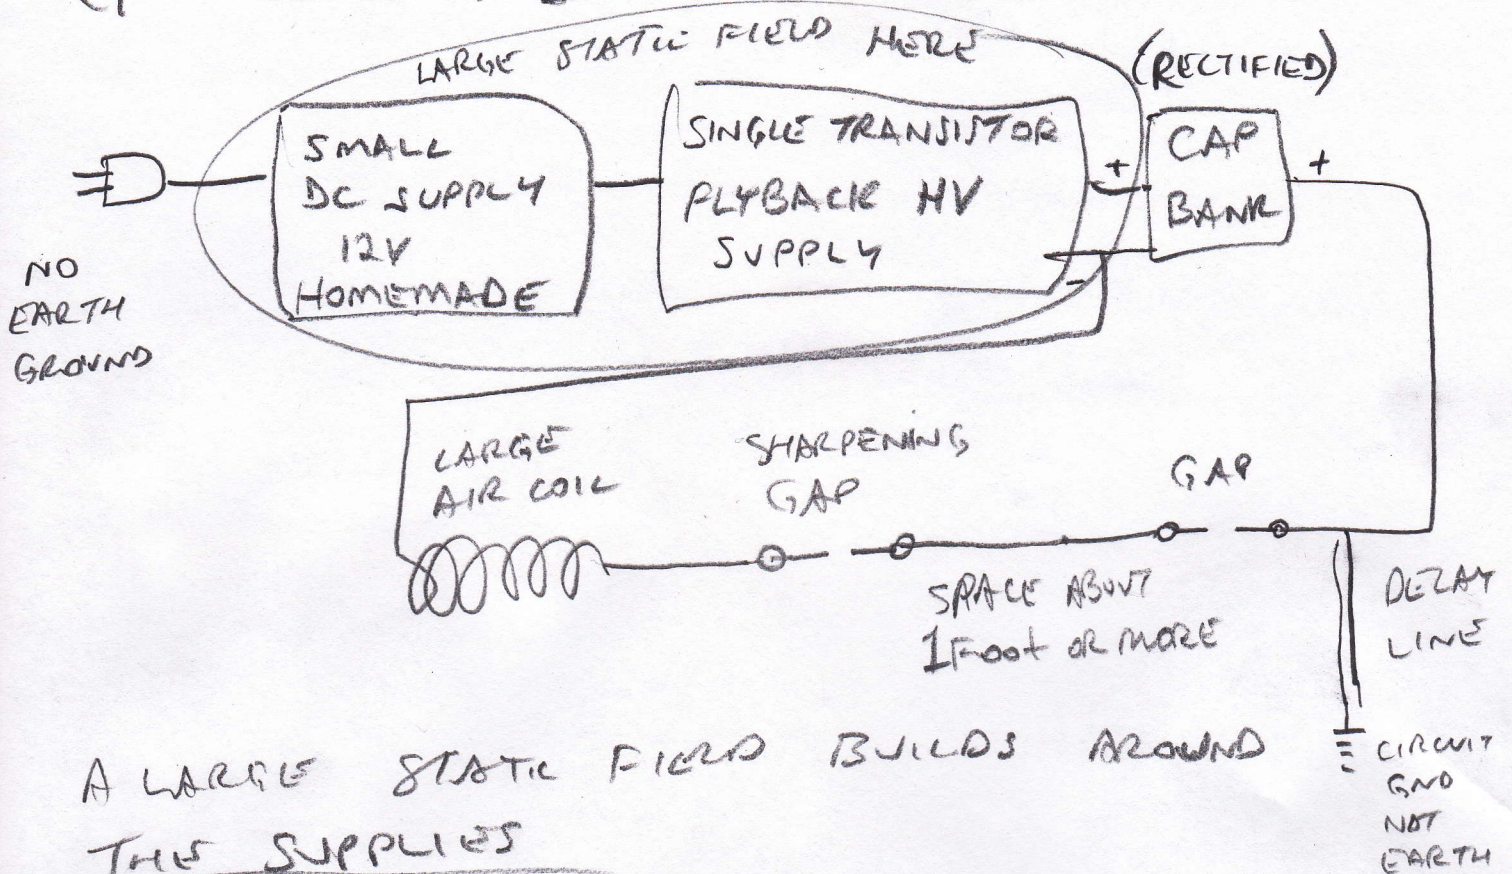

A LARGE STATIC FIELD BUILDS AROUND
THE SUPPLIES
USUALLY, NOT ALWAYS, SHORTS TRANSISTOR WHEN
FIELD IS DISCHARGED TO GROUND.

G - CONFIG 2

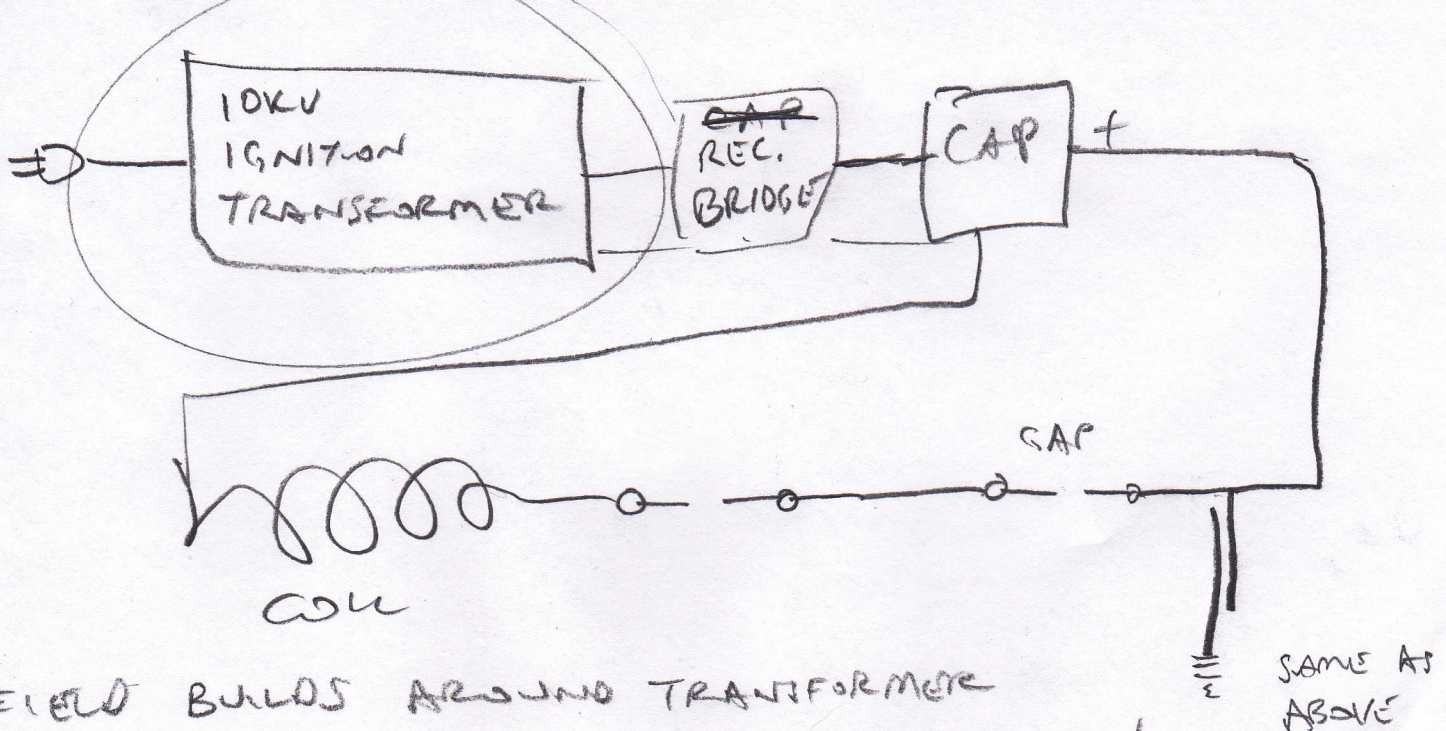

FIELD BUILDS AROUND TRANSFORMER
WILL DISCHARGE W/ LOUD BANG - NO FLASH!